



## Vulcan Installation Details

**Location:** Sheraton Saigon Grand Opera Hotel, in Ho Chi Minh, Vietnam

**Models:** One Vulcan X-Pro 1 is installed on the DN500 (20") iron pipe at the **cooling tower**.

One Vulcan X-Pro 1 is installed on the DN500 (20") iron pipe at the **chiller**.





## The Sheraton 5-star hotel

485 stylishly appointed rooms and suites overlooking the stunning city or Saigon River. A state-of-the-art Sheraton Fitness and an outdoor swimming pool. The hotel has renowned restaurants and bars. Over 2200 square meters. 14 well-equipped meeting rooms.



One Vulcan X-Pro 1 protects the cooling tower circulation line.

One Vulcan X-Pro 1 protects the chilled water circulation line.

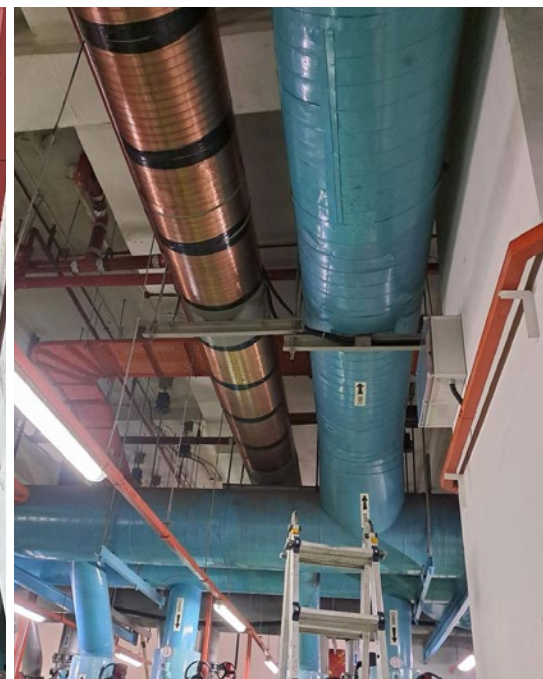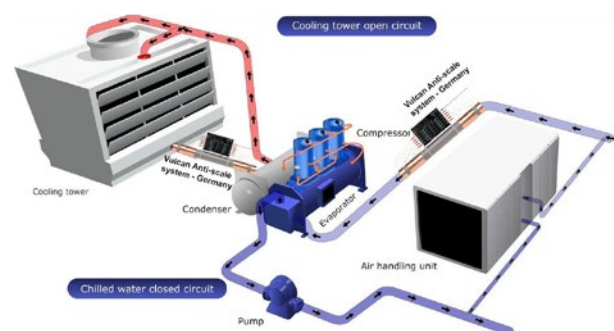

After more than one year of operating the Vulcan X-Pro 1 unit on the cooling tower water line with proven performance, the system is further extended with an additional Vulcan X-Pro 1 installed on the chilled water line.